

# RAPPORT

Birgit Östman, Lazaros Tsantaridis

## **Correlations between Cone Calorimeter Data and Time to Flashover in the Room Fire test**

---

*Paper presented at the First Japan  
Symposium on Heat Release  
and Fire Hazard, Tsukuba,  
Japan, May 1993*

**Träteknik**

Birgit A-L Östman  
Lazaros D Tsantaridis

**CORRELATIONS BETWEEN CONE CALORIMETER DATA AND TIME TO  
FLASHOVER IN THE ROOM FIRE TEST**

Paper presented at the First Japan Symposium on Heat Release and Fire Hazard,  
Tsukuba, Japan, May 1993

Trätekt, Rapport I 9306024

ISSN 1102 - 1071

ISRN TRÄTEK - R -- 93/024 -- SE

Nyckelord

*building products*  
*fire tests*  
*flashover*  
*heat release*  
*ignition*  
*room fires*  
*surface linings*  
*test method*

Stockholm juni 1993

Rapporter från Trätec — Institutet för träteknisk forskning — är kompletta sammanställningar av forskningsresultat eller översikter, utvecklingar och studier. Publicerade rapporter betecknas med I eller P och numreras tillsammans med alla utgåvor från Trätec i löpande följd.

Citat tillåtes om källan anges.

---

*Reports issued by the Swedish Institute for Wood Technology Research comprise complete accounts for research results, or summaries, surveys and studies. Published reports bear the designation I or P and are numbered in consecutive order together with all the other publications from the Institute.*

*Extracts from the text may be reproduced provided the source is acknowledged.*

Trätec — Institutet för träteknisk forskning — betjänar de fem industrigrenarna sågverk, trämanufaktur (snickeri-, trähus-, möbel- och övrig träförädlingsindustri), träfiberskivor, spånskivor och plywood. Ett avtal om forskning och utveckling mellan industrin och Nutek utgör grunden för verksamheten som utförs med egna, samverkande och externa resurser. Trätec har forskningsenheter i Stockholm, Jönköping och Skellefteå.

---

*The Swedish Institute for Wood Technology Research serves the five branches of the industry: sawmills, manufacturing (joinery, wooden houses, furniture and other woodworking plants), fibre board, particle board and plywood. A research and development agreement between the industry and the Swedish National Board for Industrial and Technical Development forms the basis for the Institute's activities. The Institute utilises its own resources as well as those of its collaborators and other outside bodies. Our research units are located in Stockholm, Jönköping and Skellefteå.*

**C O N T E N T S**

	<u>Page</u>
FOREWORD	2
SAMMANFATTNING - SWEDISH SUMMARY	3
Paper: CORRELATIONS BETWEEN CONE CALORIMETER DATA AND TIME TO FLASHOVER IN THE ROOM FIRE TEST	5
ABSTRACT	5
1. INTRODUCTION	5
2. EXPERIMENTAL	6
2.1 Tested products	6
2.2 Test methods	6
3. RELATIONS BETWEEN THE CONE CALORIMETER AND THE ROOM FIRE TEST	6
4. CONCLUSIONS	11
5. REFERENCES	12
APPENDIX: Products tested	13

**FOREWORD**

This paper was presented at the First Japan Symposium on Heat Release and Fire Hazard held in Tsukuba, Japan, May 1993. It appears in the Proceedings from the Symposium.

An appendix is added with *tables of the products tested*.

## SAMMANFATTNING - SWEDISH SUMMARY

Ett enkelt empiriskt samband har utvecklats för att beräkna tiden till övertändning i ett rum klätt med olika vägg- och takmaterial vid fullskalig rumsbrandprovning. Det baseras på provning av 28 olika ytmaterial. Bland dessa fanns både träbaserade och oorganiska material med och utan ytskikt samt syntetiska material.


För beräkningen används fysikaliskt väldefinierade data från en ny småskalig brandprovningssmetod den s.k. konkolorimetern. De standarddata som används är tid till antändning och värmeutveckling under brand. Dessutom inkluderas ytmaterialens densitet, som är ett enkelt mått på materialens termiska tröghet. Sambandet beskrivs av ekvationen:

$$t_{fo} = a \frac{t_{ig}^{0,25} \rho^{1,72}}{A^{1,30}} + b$$

där	$t_{fo}$	= tid till övertändning vid rumsbrandprovning, s
	$t_{ig}$	= tid till antändning vid 50 kW/m <sup>2</sup> i konkolorimetern, s
	A	= värmeutveckling under 5 min efter antändning vid 50 kW/m <sup>2</sup> i konkolorimetern, J/m <sup>2</sup>
	$\rho$	= ytmaterialens densitet, kg/m <sup>3</sup>
	a	= konstant, 0,0717 (J/m <sup>2</sup> ) <sup>1,30</sup> (kg/m <sup>3</sup> ) <sup>-1,72</sup> s <sup>0,75</sup>
	b	= konstant, 56,6 s

Korrelationskoefficienten för sambandet är 0,974. Det gäller för de 21 ytmaterial som ledde till övertändning vid rumsbrandprovning då materialen applicerades på både väggar och i tak. Sju av de 28 materialen ledde inte till övertändning vid rumsbrandprovning och kan därför inte jämföras direkt. Deras beräknade tid till övertändning blir längre än för övriga material, vilket överensstämmer med provningen. Resultaten illustreras i figur på nästa sida.

Arbetet är en vidareutveckling av en tidigare ansats då 13 ytmaterial ingick. De samband som erhålls med bara 13 material och med alla 28 materialen är mycket lika, vilket är en stark indikation på att det angivna sambandet ger en pålitlig uppskattning av tiden till övertändning.

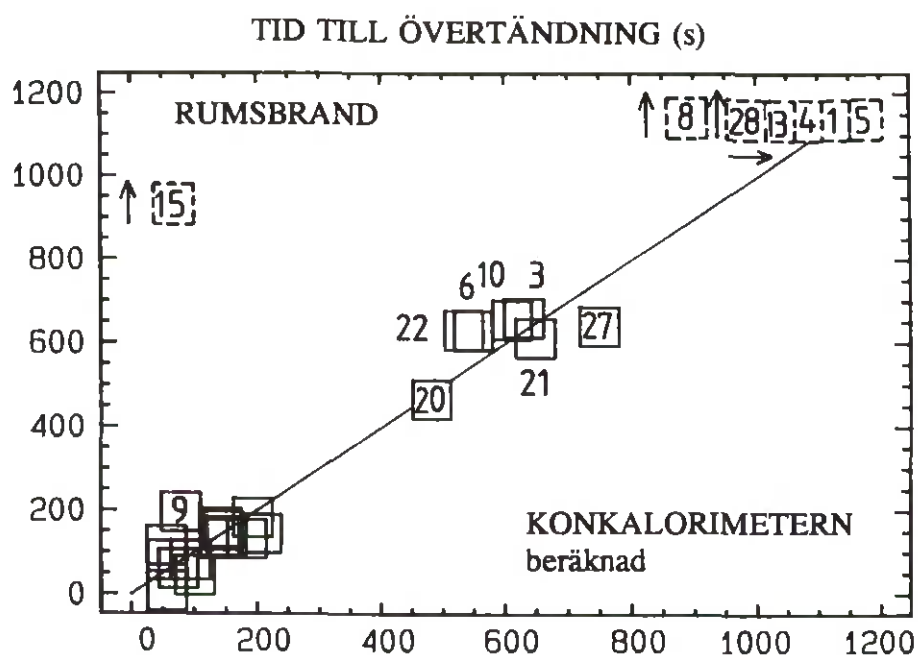

Uppmätt tid till övertändning vid rumsbrandprovning som funktion av beräknad tid till övertändning enligt data från konkalorimetern för 28 olika vägg- och takmaterial. Korrelationskoefficienten för sambandet är 0,974. (Ytmaterialen har i mån av plats identifierats med nummer, som återfinns i Appendix. Streckade kvadrater anger material som inte övertände vid rumsbrandprovning. Nr 15 är ett gränsfall, som inte övertände vid två provningar, men som övertände redan efter ca 1 min vid en tredje provning.)

## **CORRELATION BETWEEN CONE CALORIMETER DATA AND TIME TO FLASHOVER IN THE ROOM FIRE TEST**

Birgit A.-L. Östman and Lazaros D. Tsantaridis  
Swedish Institute for Wood Technology Research  
Box 5609, S-114 86 Stockholm, Sweden

### **ABSTRACT**

The correlations are based on linear regressions between data as time to ignition and total heat release in the cone calorimeter and time to flashover in the room fire test. They are a further development of an earlier approach which has been modified and extended to a wider range of surface linings. The correlations apply so far only to surface linings on both walls and ceilings. When the density of the linings is included, the correlations are improved significantly.

The new correlations are based on data readily available from the cone calorimeter test at one heat flux level, 50 kW/m<sup>2</sup>. The correlation coefficient for the basic relationship including the density of the linings is now 0.98 when applied to the 13 linings earlier investigated. This is slightly better than the earlier study in which the best correlation coefficient was 0.96. When applied to 28 linings, the correlation coefficient remains about the same, 0.97.

Very similar regression equations have been obtained when analysing only 13 products and all 28 products. This is a strong indication of the general predictive capacity of this approach. The inclusion of other data like thickness of linings or mass loss during fire does not improve the correlation coefficients. The approach is quite straightforward and simple. Still, it has proved to supply a useful prediction which is valid also for an extended range of linings.

### **1. INTRODUCTION**

The early fire behaviour of products is important in many aspects of fire safety. New fire tests have been developed e.g. within ISO in order to determine the fire behaviour of surface lining products in a more elaborate way than the present national fire test methods. The new tests are both in small and full scale. Small-scale tests are necessary as practical tools. Full-scale tests are generally considered to be more reliable and are needed to validate the small-scale tests. A full-scale standard room fire test is widely used /1/. Among the small-scale tests, the cone calorimeter /2/ is considered to be the most useful and universal instrument. However, the relationships between small-scale and full-scale fire tests are of major interest. Early attempts have been demonstrated /10, 11/. Several empirical correlations or models have been proposed /12, 13, 14, 15/. In other studies, parameters as flame spread have been included for more advanced modelling /16, 17, 18/.

In this study, an earlier empirical approach /9/ will be modified and extended to a wider range of products.

## 2. EXPERIMENTAL

### 2.1 Tested products

Three sets of building products have been included: a new set of 11 Eurefic products /3,6/, another new set of 4 products from the Nordic round robin within ISO TC 92/SC 1/WG 7 for the room fire test /4,7/ and an old set of 13 products earlier frequently used for fire studies in Scandinavia /5,8/. Thus, a total of 28 building products are included in this paper, see [Table 1](#).

### 2.2 Test methods

The room fire tests have been performed according to ISO 9705 /1/ at different Nordic laboratories: for the 11 EUREFIC and the 4 Nordic round robin products at the national fire laboratories in Finland, Norway and Sweden /3,4/ and for the 13 Scandinavian products at the Swedish National Testing Institute /5/. All tests have been performed with both the walls and the ceiling covered with the lining products. An ignition source of 100 kW is placed in one of the inner corners. If flashover does not occur within 10 minutes, the ignition source is raised to 300 kW. The maximum test time is 20 minutes. A large number of parameters are measured, but in this paper only the time to flashover will be used for characterizing the fire behaviour of the tested products.

The cone calorimeter tests have been performed according to ISO 5660 /2/ with horizontal specimens. All products have been tested by using the recommended stainless steel retainer frame /6,7,8/ and with a low density ( $65 \text{ kg/m}^3$ ) fiber blanket as backing material according to the standard. Only data at a heat flux level of  $50 \text{ kW/m}^2$  have been chosen, since all products ignite at  $50 \text{ kW/m}^2$ , but not at  $25$  and  $35 \text{ kW/m}^2$ . The total heat release, the time to ignition and the mass loss were the parameters used in this paper.

## 3. RELATIONS BETWEEN THE CONE CALORIMETER AND THE ROOM FIRE TEST

The aim has been to find a relation between basic parameters from the cone calorimeter and time to flashover in the room fire test. It is an extension of an earlier approach /9/. The cone calorimeter parameters used in this paper are based on data available from the standard test procedure at one heat flux level,  $50 \text{ kW/m}^2$ . They are calculated from ignition to 5 minutes after ignition. The time to flashover in the room fire test is defined as the time to reach 1 MW heat release. All data are listed in [Table 1](#).

The relations are all of the form  $y = ax + b$ , where  $y$  is time to flashover in the room fire test and  $x$  is an expression based on different cone calorimeter parameters. The different parameters  $x$  have different exponents, see [Table 2](#). The constants  $a$  and  $b$  and the exponents have been determined by linear regression analyses using a standard statistics computer program.

The analyses are made both for the 13 Scandinavian products and for all the 28 products. This makes it possible to compare the results with the earlier approach for the 13 products /9/. One product, no 28, of the 13 Scandinavian products did not reach flashover. Seven products, nos. 1, 4, 5, 8, 13, 15, 28, of all the 28 products did not reach flashover. These products are therefore not included in the analyses.

**Table 1. Time to flashover in the room fire test and Cone calorimeter data with retainer frame at 50 kW/m<sup>2</sup> and horizontal orientation.**

Products	Room test	Cone	calorimeter	
	Time to flashover	Time to ignition	THR <sub>300</sub> <sup>1)</sup>	Mass <sup>2)</sup> loss <sub>300</sub>
	min:s	s	MJ/m <sup>2</sup>	kg 10 <sup>-3</sup>
1. Painted gypsum paper plasterboard	> 20	47	7.0	10.7
2. Ordinary birch plywood	2:30	30	38.0	37.0
3. Textile wallcovering on gypsum paper plasterboard	11:00	25	12.8	14.8
4. Melamine-faced high-density non-combustible board	> 20	29	9.8	17.0
5. Plastic-faced steel sheet on mineral wool	> 20	53	3.7	1.9
6. FR particle board, type B1	10:30	21	10.4	18.7
7. Combustible-faced mineral wool	1:20	5	4.0	0.9
8. FR particle board	> 20	700	17.0	13.8
9. Plastic-faced steel sheet on polyurethane foam	3:15	19	17.2	14.2
10. PVC-wallcarpet on gypsum paper plasterboard	10:55	15	11.9	15.3
11. FR extruded polystyrene foam	1:20	31	22.3	7.8
12. Birch plywood	2:17	28	35.5	33.8
13. FR plywood	> 20	469	8.7	4.9
14. Melamine-faced particle board	3:02	34	32.9	23.0
15. FR polystyrene foam	> 20	25	24.2	6.8
16. Particle board	2:37	34	45.9	32.1
17. Insulating wood fiber board	0:59	12	33.2	22.3
18. Medium-density wood fiber board	2:11	31	32.6	31.5
19. Wood panel, spruce	2:11	20	25.0	25.1
20. Melamine-faced particle board	7:45	41	19.8	25.1
21. Plastic wallcovering on gypsum board	10:11	10	9.2	11.9
22. Textile wallcovering on gypsum board	10:29	20	12.1	14.7
23. Textile wallcovering on rockwool	0:43	11	8.5	4.6
24. Paper wallcovering on particle board	2:23	33	29.8	29.3
25. Rigid polyurethane foam	0:06	2	17.4	8.9
26. Expanded polystyrene	1:55	39	32.8	9.9
27. Paper wallcovering on gypsum board	10:40	21	9.4	10.5
28. Gypsum board	> 20	34	6.7	9.1

<sup>1)</sup> THR<sub>300</sub> = total heat release during 5 minutes after ignition (calculated per 0.01 m<sup>2</sup> sample area).

<sup>2)</sup> Mass loss<sub>300</sub> = mass loss during 5 minutes after ignition.

**Table 2.** Correlation coefficients,  $r$ , between different cone calorimeter parameters and time to flashover in the room fire test.

Regression equation nos.	No of products reaching flashover	Expressions based on cone calorimeter parameters $x^*$	Constants in eqs. a	1-10 b	Correlation coefficients $r$
1.	12	$t_{ig}^{1.05}/A^{1.43}$	$6.846 \cdot 10^2$	-12.8	0.784
2.	12	$t_{ig}^{0.14} \rho^{2.20}/A^{1.18}$	$2.977 \cdot 10^{-3}$	45.3	0.980
3.	12	$t_{ig}^{0.42}/(A^{1.39} \delta^{1.30})$	$1.807 \cdot 10^1$	-28.7	0.938
4.	12	$t_{ig}^{0.61} m^{1.75}/(A^{3.29} \delta^{0.89})$	$1.083 \cdot 10^7$	32.8	0.981
5.	12	$t_{ig}^{0.71} m^{2.52}/A^{4.09}$	$7.016 \cdot 10^{10}$	45.9	0.981
6.	21	$t_{ig}^{1.36}/A^{1.50}$	$3.144 \cdot 10^2$	-8.5	0.742
7.	21	$t_{ig}^{0.25} \rho^{1.72}/A^{1.30}$	$7.171 \cdot 10^{-2}$	56.6	0.974
8.	21	$t_{ig}^{0.62}/(A^{1.77} \delta^{2.44})$	$1.772 \cdot 10^{-1}$	32.3	0.913
9.	21	$t_{ig}^{0.50} m^{1.06}/(A^{2.74} \delta^{2.46})$	$2.186 \cdot 10^2$	58.3	0.957
10.	21	$t_{ig}^{0.23} m^{0.57}/A^{1.07}$	$6.170 \cdot 10^4$	-249	0.916

\* Linear regressions of the form  $y = ax + b$ , where  $y$  is time to flashover in room fire test and  $x$  is an expression based on different cone calorimeter parameters at 50 kW/m<sup>2</sup>:

$t_{ig}$  time to ignition, s  
 $A$  total heat release (THR<sub>300</sub>), J/m<sup>2</sup>  
 $m$  mass loss, kg  
 $\rho$  density, kg/m<sup>3</sup>  
 $\delta$  thickness, m

A prediction based on only total heat release and time to ignition provides low correlation coefficients, 0.74 - 0.78, see regression eqs. 1 and 6 in [Table 2](#). Better correlation coefficients, 0.97 - 0.98, are obtained if the density is considered as well, see regression eqs. 2 and 7. After that no further improvements have been found when including all 28 products. If both the thickness and the mass loss are included instead of density, the correlation coefficient remains about the same, 0.981, for the 13 products, but is slightly decreased to 0.957 for all 28 products, see regression eqs. 4 and 9. When only the mass loss is included instead of density, the correlation is the same, 0.981, for the 13 products but decreased to 0.916 for all 28 products, see regression eqs. 5 and 10. When only the thickness is included instead of density the correlation coefficients are decreased in both cases, regression eqs. 3 and 8.

Three predictive expressions in [Table 2](#) give correlation coefficients of about 0.98 for the 13 Scandinavian products. Only one of these gives a good correlation coefficient also for all the 28 products, 0.974. It is the correlation for total heat release, time to ignition and density, regression eq. 7, which is described by the equation:

$$t_{fo} = a \frac{t_{ig}^{0.25} \rho^{1.72}}{A^{1.30}} + b$$


where

- $t_{fo}$  = time to flashover in room fire test, s
- $t_{ig}$  = time to ignition in cone calorimeter at 50 kW/m<sup>2</sup>, s
- $A$  = total heat release during 5 minutes after ignition at 50 kW/m<sup>2</sup> (THR<sub>300</sub>), J/m<sup>2</sup>
- $\rho$  = density, kg/m<sup>3</sup>
- $a$  = constant, 0.0717 (J/m<sup>2</sup>)<sup>1.30</sup> (kg/m<sup>3</sup>)<sup>-1.72</sup> s<sup>0.75</sup>
- $b$  = constant, 56.6 s

Some of the regressions are also given in [Figure 1](#) in which the products not reaching flashover in the room fire test are marked by dashed squares. Those products get in most cases predicted times to flashover which are longer than 20 minutes. When evaluating the best predictive expression, eq. 7, there are two exceptions: product no 15, a fire retardant polystyrene foam, and product no 8, a fire retardant particle board. Product no 15 gets a short predicted time to flashover, only about one minute, but was hard to test in the room fire tests /4/. In two of the room fire tests it did not reach flashover, but in a third test it flashed over in 67 seconds. The reason for these differences is most probably differences in the methods of glueing the sample to the substrate /4/. It is thus quite understandable that its behaviour is hard to predict. Product no 8 gets about 15 minutes in predicted time to flashover which is more reasonable. For the other five products not reaching flashover in the room fire test, the predicted time to flashover is more than 20 minutes.


The results are also presented in [Figure 2](#) as simple stepwise ranking orders according to regression eq. 2 for the 13 products and to eq. 7 for the 28 products. Ranking order 1 means longest time to flashover. It is obvious that the agreement is quite good for all products with the exception of product no 15, as mentioned above. Product no 9, a plastic-faced steel sheet on polyurethane foam, is also a slight outlier.

The predictive eq. 2 obtained for the 13 Scandinavian products seems to fit also all the 28 products surprisingly well as shown in [Figure 3](#). The correlation coefficient is 0.971, which should be compared with 0.974 for eq. 7. The main differences compared to eq. 7 in [Figure 1](#) are that product nos. 8 and 13 get a better agreement with the experimental data in [Figure 1](#). All other products get about the same predictions. Eq. 7 should therefore be preferred.

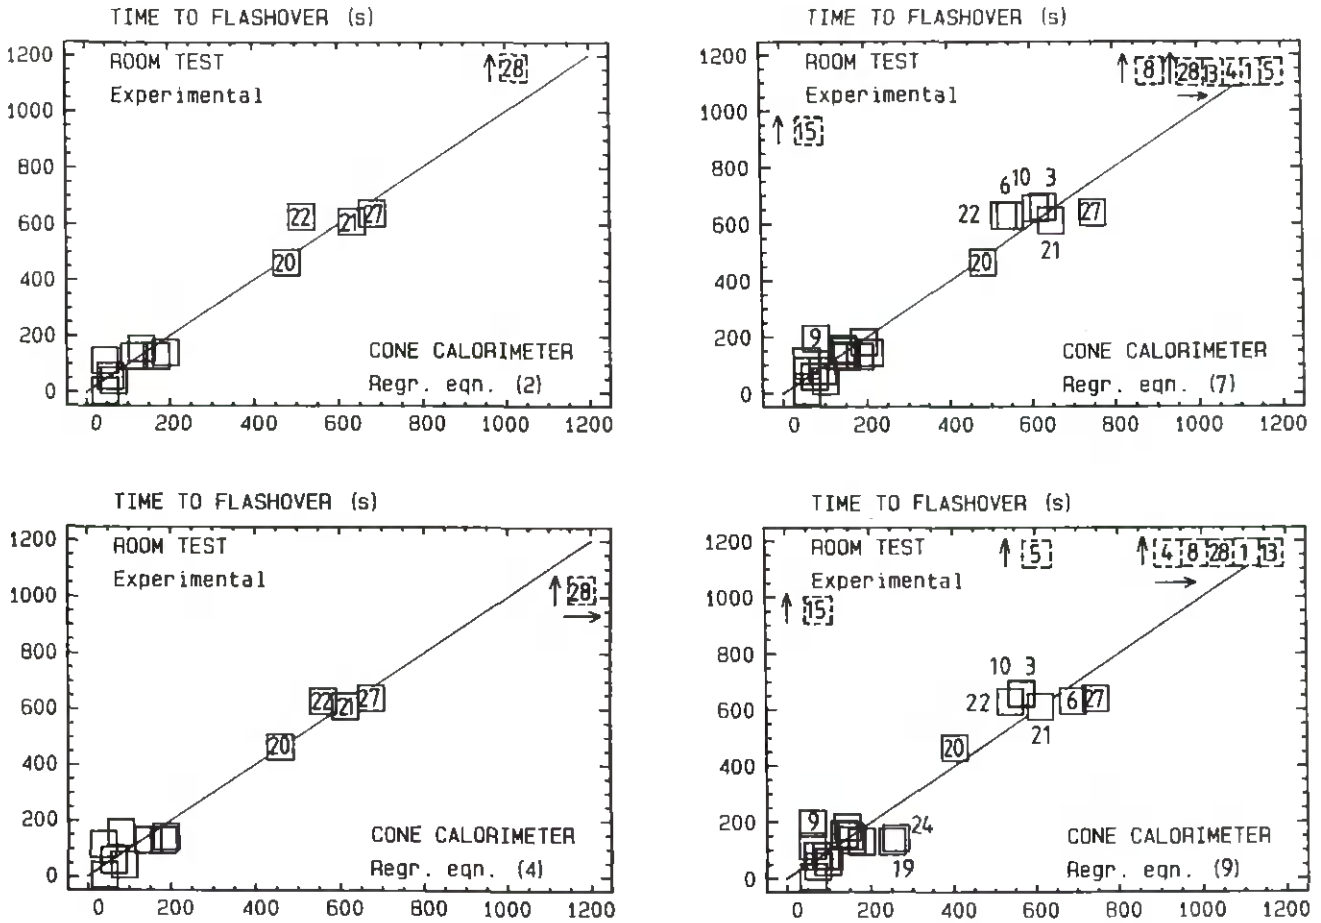


**Figure 1.**

Time to flashover in the room fire test vs predicted time to flashover from cone calorimeter data according to different regression equations, see Table 2. To the left for the 13 Scandinavian products and to the right for all 28 products. Where possible the products are identified by product numbers. One product, no 28, of the 13 and seven products, nos. 1, 4, 5, 8, 13, 15, 28, of the 28 products did not reach flashover in the room fire test and are marked by dashed squares.

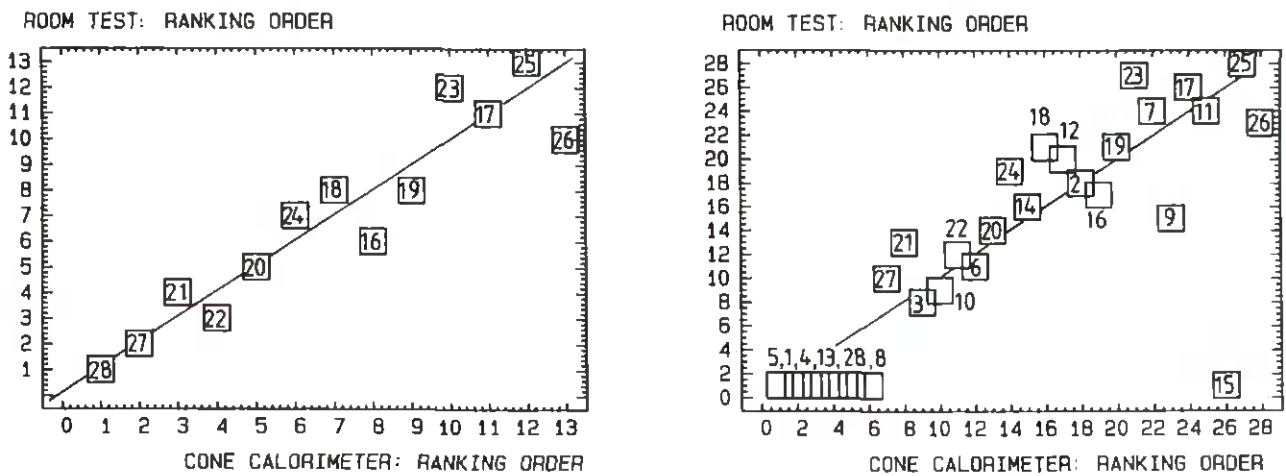

**Figure 2.**

Stepwise ranking order of products according to the room fire test and cone calorimeter predictions. Ranking order 1 means longest time to flashover. To the left for the 13 Scandinavian products according to eq. 2, to the right for all 28 products according to eq. 7.

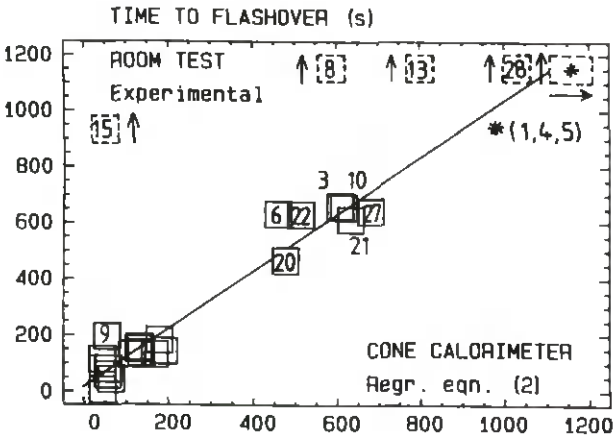

**Figure 3.**

The regression eq. 2 for the 13 products fits also all the 28 products fairly well. The correlation coefficient is in this case 0.971, which should be compared with 0.974 for eq. 7 based on all 28 products.

(See upper diagram to the right in Figure 1)

**CONCLUSIONS**

A very simple linear regression equation has been developed for predicting the time to flashover in the room fire test based on cone calorimeter data. The equation is thus based on basic physical parameters but does not assume any specific physical or theoretical model of the fire.

The cone calorimeter data used are time to ignition and total heat release during 5 minutes after ignition, both measured at an irradiance of 50 kW/m<sup>2</sup>. Those cone calorimeter data are combined with the density of the lining product, which reflects the influence of the thermal inertia on the early fire growth. Other data like thickness of linings or mass loss during fire do not improve the regressions when all products are included.

The approach is a modification of an earlier study with 13 products. It is also an extension to another 15 products, i.e. totally 28 products. Very similar regression equations have been obtained when analysing only 13 products and all 28 products. This is a strong indication of the general predictive capacity of this approach.

The regression equation can be simplified to

$$t_{fo} = 0.07 \frac{t_{ig}^{0.25} \rho^{1.7}}{A^{1.3}} + 60$$

- where  $t_{fo}$  = time to flashover in room fire test, s
- $t_{ig}$  = time to ignition in cone calorimeter at 50 kW/m<sup>2</sup>, s
- A = total heat release during 5 minutes after ignition at 50 kW/m<sup>2</sup> (THR<sub>300</sub>), J/m<sup>2</sup>
- $\rho$  = density, kg/m<sup>3</sup>

The equation is so far valid only for the room scenario studied with linings on both walls and ceiling. However, it can still serve as a simple tool for predictions of this scenario which is widely used and as an alternative to more advanced models. It might also be extended to other scenarios when more data become available.

## 5. REFERENCES

- /1/ ISO 9705. Fire tests - Full scale room test for surface products. International Organization for Standardization, 1990.
- /2/ ISO 5660. Fire tests - Reaction to fire - Rate of heat release from building products. International Organization for Standardization, 1990.
- /3/ Söderbom, J.: Full scale tests according to ISO DIS 9705 for the EUREFIC materials. Swedish National Testing Institute, SP-Report 1991:27, 1991.
- /4/ Mangs, J., Mikkola, E., Kokkala, M., Söderbom, J., Stenhaug, E. and Østrup, I: Room/corner test round robin. Technical Research Centre of Finland. Report 733, 1991.
- /5/ Sundström, B.: Full scale fire testing of surface materials. Swedish National Testing Institute, SP-Report 1986:45, 1986.
- /6/ Tsantaridis, L.: Cone calorimeter data for the EUREFIC products using and not using a retained frame. Swedish Inst. for Wood Techn. Research, Träteknik Report P 9208054, 1992.
- /7/ Tsantaridis, L. and Mikkola, E.: Cone calorimeter results for four Nordic materials tested earlier in full scale. Swedish Inst. for Wood Techn. Research, Träteknik Report L 9010052, 1990.
- /8/ Tsantaridis, L. and Östman, B.: Smoke, gas and heat release data for building products in the cone calorimeter. Swedish Inst. for Wood Techn. Research, Träteknik Report I 8903013, 1989.
- /9/ Östman, B.A-L. and Nussbaum, R.M.: Correlation between small-scale rate of heat release and full-scale room flashover for surface linings. Proc. Second Internat. Symp. on Fire Safety Science, 823-32. Tokyo 1988. Hemisphere Publ. Corp.
- /10/ Smith, E.E. and Satija, S.: Release rate model for developing fires. J. Heat Transfer, 105, 281-287, May 1983.
- /11/ Babrauskas, V.: Bench-scale methods for predictions of full-scale fire behaviour of furnishings and wall linings. Techn. Report 84-10, Soc. of Fire Prot. Eng., Boston 1984.
- /12/ Wickström, U. and Göransson, U.: Prediction of heat release rates of surface materials in large-scale fire tests based on cone calorimeter results. ASTM J. of Testing and Evaluation, 15, 6, 1987.
- /13/ Deal, S. and Beyler, C.: Correlating preflashover room fire temperatures. J. of Fire Prot. Engr., 2, 2, 33-48, 1990.
- /14/ Tran, H.C.: Experimental aspects of validating a compartment wall fire model. Proc. Interflam 90, 13-24, Interscience Comm. Ltd., 1990.
- /15/ Mowrer, F.W. and Williamson, R.B.: Flame spread evaluation for thin interior finish materials. Proc. Third Internat. Symp. on Fire Safety Science, 689-698, Elsevier Applied Science, 1991.
- /16/ Hasemi, Y. and Tokunaga, T.: Modeling of turbulent diffusion flames and fire plumes for the analysis of fire growth. In Fire dynamics and heat transfer, Amer. Soc. of Mech. Engrs., 21st Nat. Heat Transfer Conf., Seattle WA, 1983.
- /17/ Karlsson, B., Magnusson, S.E. and Andersson, B.: Numerical simulation of room fire growth on combustible linings and a rational classification model. Proc. Interflam 90, 43-54, Interscience Comm. Ltd., 1990.
- /18/ Quintiere, J.G.: A simulation model for fire growth on materials subject to a room-corner test. University of Maryland, USA. Report 1992.

## A P P E N D I X

### Products tested.

#### EUREFIC products.

No.	Product	Thickness mm	Density kg/m <sup>3</sup>	Surface weight g/m <sup>2</sup>
1.	Painted gypsum paper plasterboard	12	800	100***
2.	Ordinary birch plywood	12	600	
3.	Textile wallcovering on gypsum paper plasterboard	12+1 *	800	505*****
4.	Melamine-faced high density non-combustible board	12+1.5 *	1055**	
5.	Plastic-faced steel sheet on mineral wool	23+0.15+ +0.7 *	640**	
6.	FR particle board, type B1	16	630	
7.	Combustible-faced mineral wool	30+1 *	87**	37
8.	FR particle board	12	750	
9.	Plastic-faced steel sheet on polyurethane foam	80+0.1+ +1 *	160**	
10.	PVC-wallcarpet on gypsum paper plasterboard	12+0.9 *	800	1250*****
11.	FR extruded polystyrene foam	25	37	

\* Thickness of surface layer(s).

\*\* Total.

\*\*\* Paint weight.

\*\*\*\*\* Base paper + surface covering.

## Nordic round robin products.

No.	Product	Thickness mm	Density kg/m <sup>3</sup>
12.	Birch plywood	12	600
13.	FR plywood	9	620
14.	Melamine-faced particle board	12+0.1 *	680
15.	FR polystyrene	25	30

\* Thickness of surface layer.

## Scandinavian products.

No.	Product	Thickness mm	Density kg/m <sup>3</sup>
16.	Particle board	10	670
17.	Insulating wood fiber board	13	250
18.	Medium density wood fiber board	12	655
19.	Wood panel, spruce	11	450
20.	Melamine-faced particle board	12+1 *	870
21.	Plastic wallcovering on gypsum board	13+0.7 *	725
22.	Textile wallcovering on gypsum board	13+0.5 *	725
23.	Textile wallcovering on rockwool	42+0.5 *	150
24.	Paper wallcovering on particle board	10+0.5 *	670
25.	Rigid polyurethane foam	30	32
26.	Expanded polystyrene	49	18
27.	Paper wallcovering on gypsum board	13+0.5*	725
28.	Gypsum board	13	725

\* Thickness of surface layer.

Detta digitala dokument  
skapades med anslag från  
**Stiftelsen Nils och Dorthi  
Troëdssons forskningsfond**

**Träte**

INSTITUTET FÖR TRÄTEKNISK FORSKNING

Box 5609, 114 86 STOCKHOLM  
Besöksadress: Drottning Kristinas väg 67  
Telefon: 08-14 53 00  
Telefax: 08-11 61 88

Åsensvägen 9, 553 31 JÖNKÖPING  
Telefon: 036-30 65 50  
Telefax: 036-30 65 60

Skeria 2, 931 87 SKELLEFTÅ  
Besöksadress: Laboratorgrän  
Telefon: 0910-652 00  
Telefax: 0910-652 65